


Possible HIV Self-Test Results



PARKDALE
QUEEN WEST
Community
Health Centre


ONE BLUE DOT ON TOP

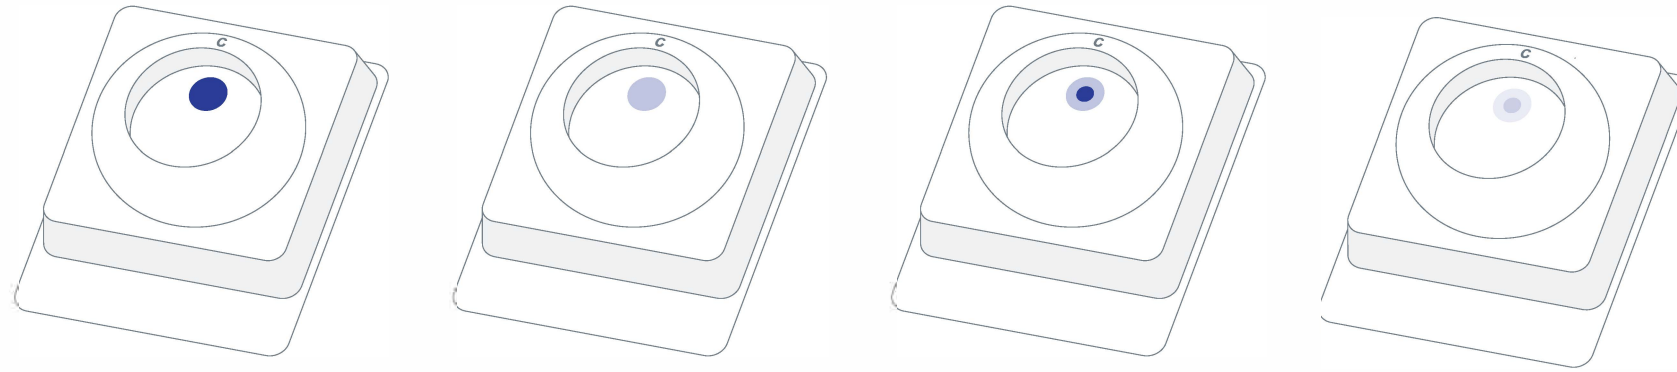

NON-REACTIVE (NEGATIVE)

- If a contact of concern was less than 3 months ago, repeat testing at 3 weeks, 6 weeks & 3 months.
- If contact of concern was more than 3 months ago testing is complete.

TWO BLUE DOTS

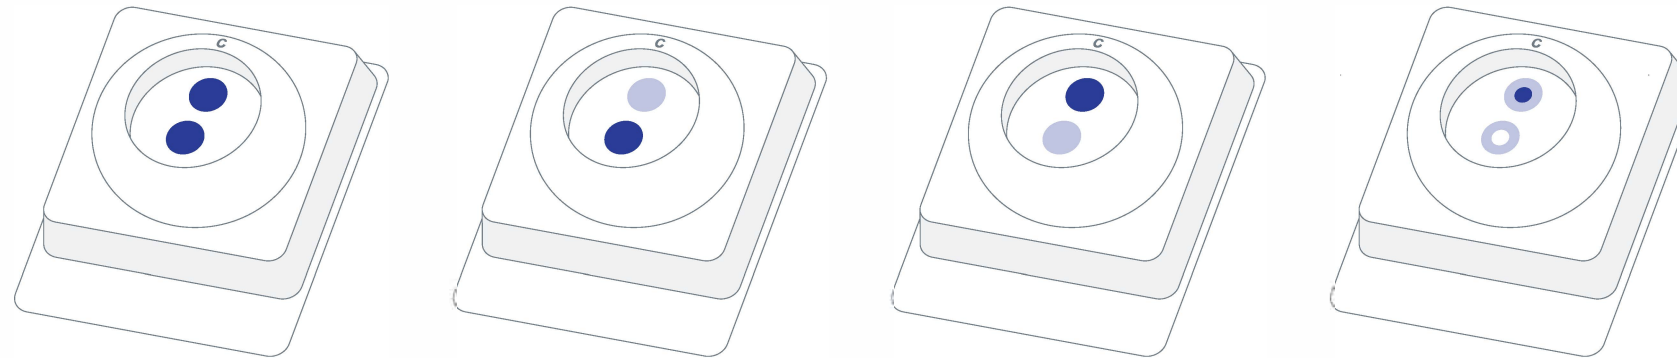


REACTIVE (POSITIVE)

- Although rarely wrong, a positive result from your self-test kit is considered a preliminary diagnosis and must be confirmed by a lab test.
- Book an anonymous confirmatory testing appointment at:

<http://tinyurl.com/ypmr99ew>

OTHER RESULTS

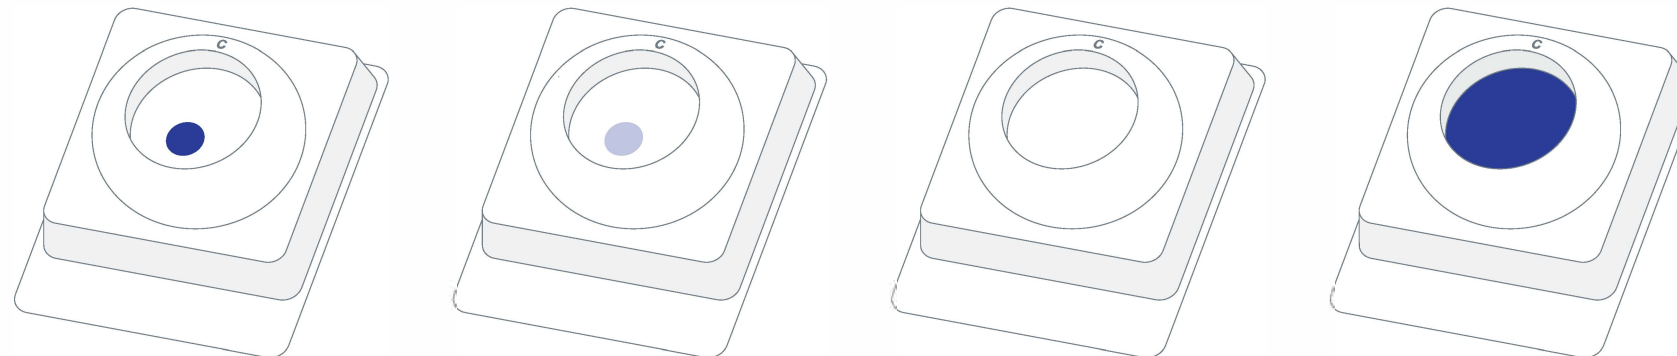

KIT ERROR (INVALID)


- Repeat the test with a new kit.
- If test shows an invalid a second time come in for anonymous testing, book here: <http://tinyurl.com/ypmr99ew>

Résultat de votre auto-test pour le VIH



PARKDALE
QUEEN WEST
Community
Health Centre


UN POINT BLEU EN HAUT

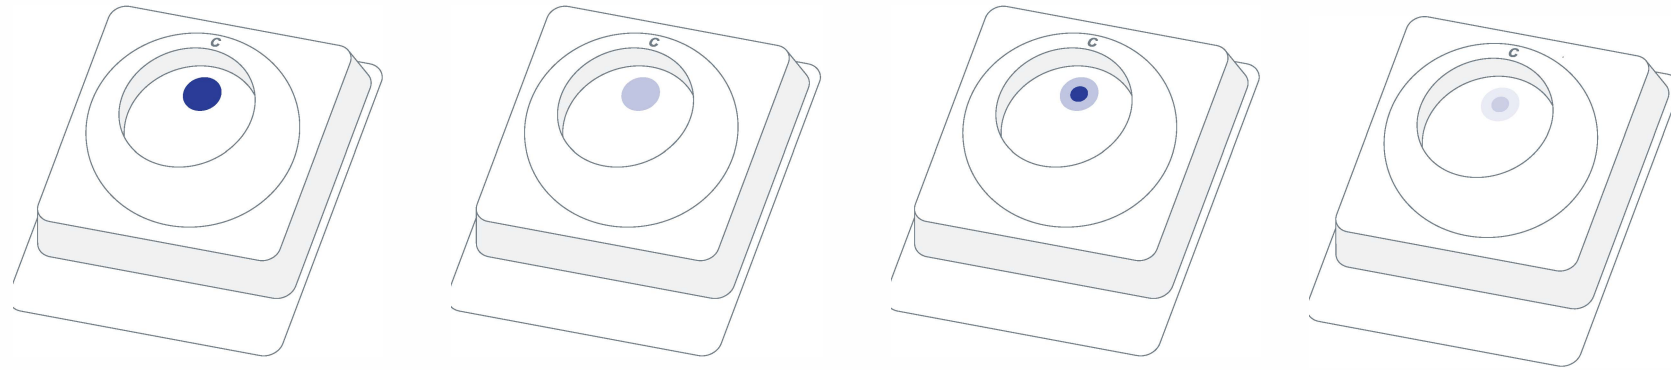

NÉGATIF

- Répéter votre test dans 3 mois après votre contact à risque.


DEUX BLEUS POINTS

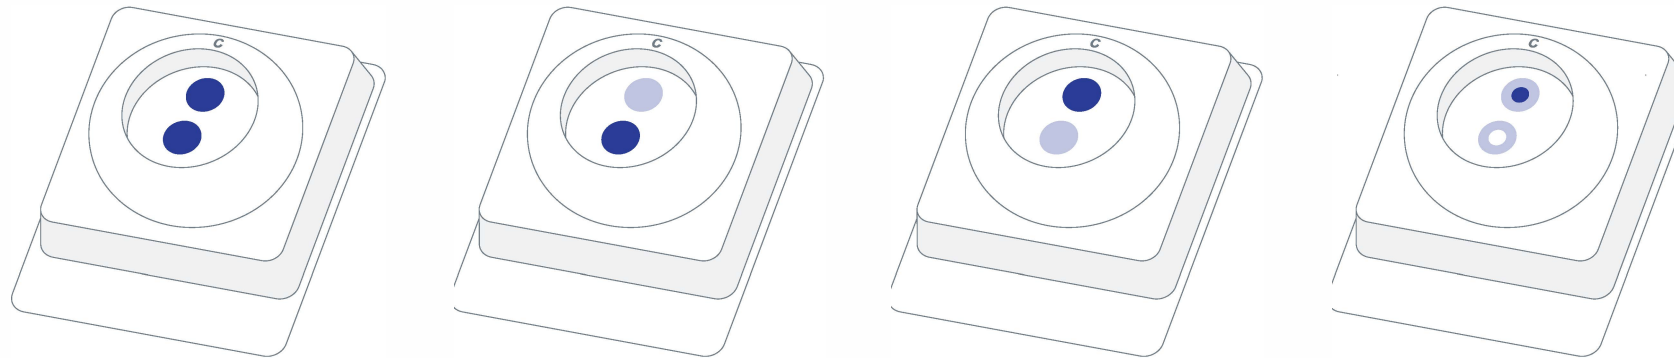

POSITIF

- Un résultat positif est considéré comme un diagnostic préliminaire et doit être confirmé par une prise de sang.

AUTRES RÉSULTATS

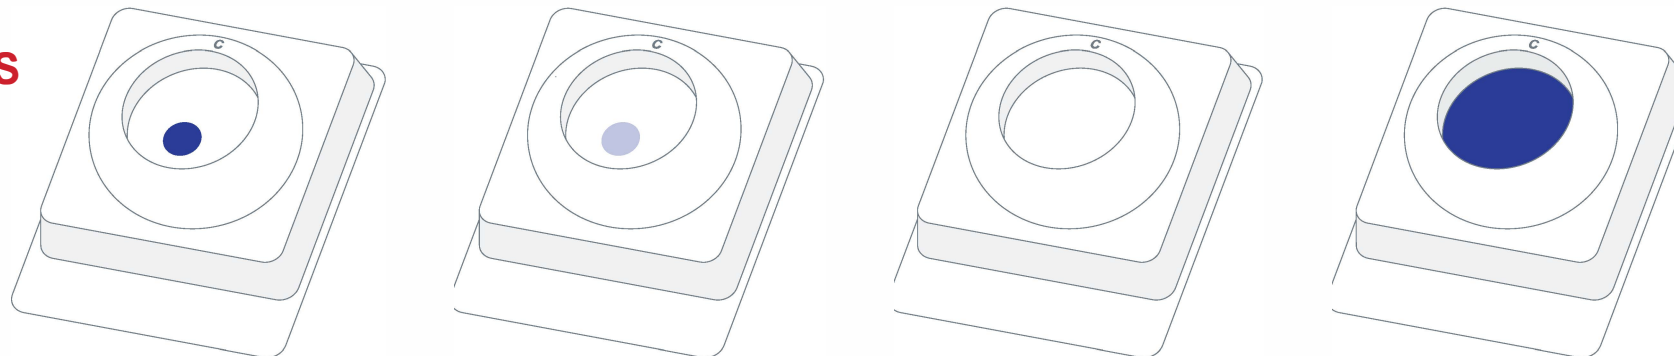

NON VALIDE

- Commander un nouveau kit.
- Si votre test est non valide une deuxième fois, un test sanguin pour le VIH est recommandé.